

Product data sheet

Specifications



Subscription, PowerChute Network Shutdown for Virtualization and HCI, 1 year

SWPCNS1Y-DIGI

Overview

Presentation

1-year subscription for PowerChute Network Shutdown.
Contact your Partner to purchase this subscription.

Lead time

Usually in Stock

Main

Range of Product

PowerChute Network Shutdown

Product or Component Type

Subscription

Format

Digital key

Subscription period

1 year

Subscription type

Paid

Software Type

Subscription software

Range Compatibility

Smart-UPS
Smart-UPS Ultra
Smart-UPS Online
Smart-UPS Modular Ultra
Easy UPS On-Line
Symmetra
Galaxy VL
Galaxy VM
Galaxy VS
Galaxy VX
Galaxy VXL

Software Version

V5.2

Operating system requirement

VMware ESXi
VMware vSAN
Nutanix ESXi
Nutanix AHV
Dell VxRail
Microsoft Hyper-V
HPE SimpliVity
Cisco HyperFlex

User Language

English

Complementary

Software Designation

PowerChute Network Shutdown software

Software Function

Activate PowerChute Network Shutdown

Ordering and shipping details

GTIN

731304452980

Price is "List Price" and may be subject to a trade discount – check with your local distributor or retailer for actual price.



Environmental Data

Schneider Electric aims to achieve Net Zero status by 2050 through supply chain partnerships, lower impact materials, and circularity via our ongoing “Use Better, Use Longer, Use Again” campaign to extend product lifetimes and recyclability.

[Environmental Data explained >](#)

[How we assess product sustainability >](#)

Use Longer



Lifetime extension

Repair

No

Offer Marketing Illustration

Product benefits / Features

PowerChute Network Shutdown Benefits



Protect Virtual Infrastructure

Unattended, graceful shutdown of virtual machines and hosts during power events - ensuring data integrity and uptime.



Easy Access and Configuration

Intuitive step-by-step configuration wizard avoids any guesswork, reducing installation and set-up time.




Integrate With Confidence

Validated compatibility with VMware, Hyper-V, and other platforms for seamless deployment and reliable performance.



Image of product / Alternate images

Alternative

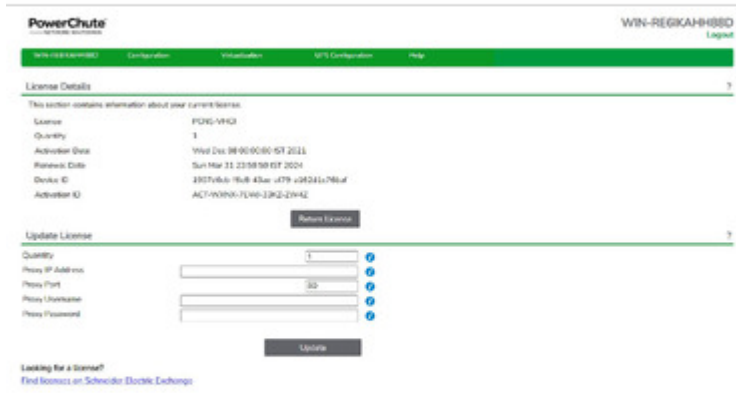

PowerChute
WIN-REGKAH488D

WIN-REGKAH488D Configuration Virtualization UPS Configuration Help


Event Log



Delete Log File Export Log


Display 25 items
Events 1 to 15 of 17

Date	Time	Event
09/19/2012	15:32:31	vCenter Server is accessible. PowerChute will be able to issue commands to VM Guest Machines or Tools.
09/19/2012	15:29:52	Cannot connect to vCenter Server. PowerChute may not be able to issue commands to VM Guest Machines or Tools.
09/19/2012	15:02:03	Three unsuccessful login attempts detected. To temporarily disable login attempts from IP address 10.179.211.53.
09/19/2012	14:57:38	Three unsuccessful login attempts detected. To temporarily disable login attempts from IP address 10.179.211.53.
09/19/2012	14:22:07	UPS is no longer running on battery power or output power has been turned on.
09/19/2012	14:22:03	UPS has switched to battery power.
09/19/2012	09:29:28	Available runtime has been exceeded.
09/19/2012	09:29:28	Communication has been established.
09/19/2012	09:29:06	PowerChute software successfully accessed TCP port 55461.
09/19/2012	09:29:06	PowerChute is attempting to access TCP port 55461.
09/19/2012	09:29:03	PowerChute Network Shutdown monitor 5.0.0 monitoring started.
09/19/2012	09:28:18	PowerChute successfully accessed UDP port 3062.



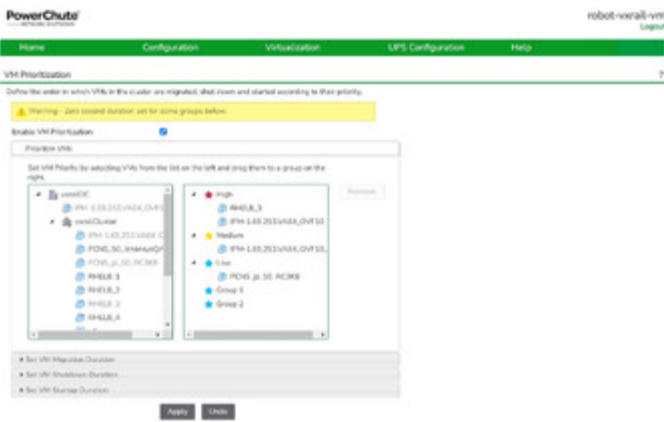

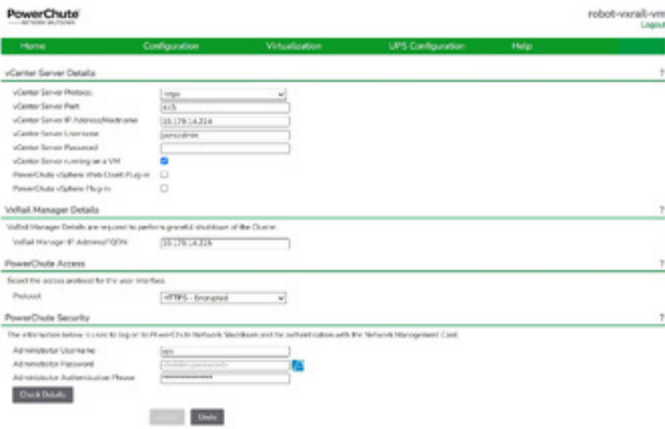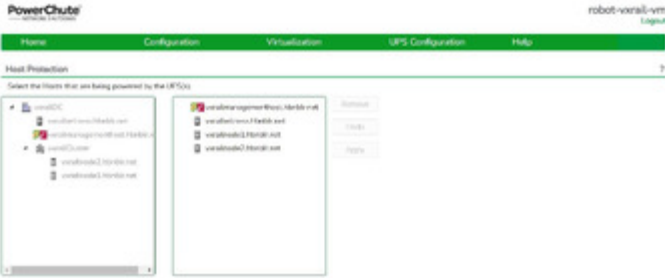

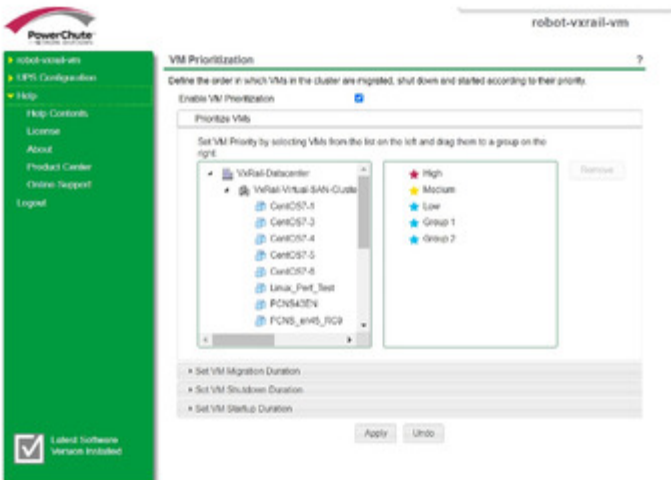

PowerChute robot-vorall-vm
Logout

Home Configuration Visualization UPS Configuration Help

Configure Events ?

Click on an icon to configure a PowerChute event action in response to UPS events.

Event	Logging	Notification	Command File	Shutdown
UPS On-Battery	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Input Power Fluctuates	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Auxiliary overloaded	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Runtime is sufficient	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Runtime remaining below threshold	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Runtime remaining above threshold	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Battery Discharged	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Battery Recharged	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Shutdown due to hardware error or overload	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Shutdown failed	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Maintenance bypass	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>